


Sectional view

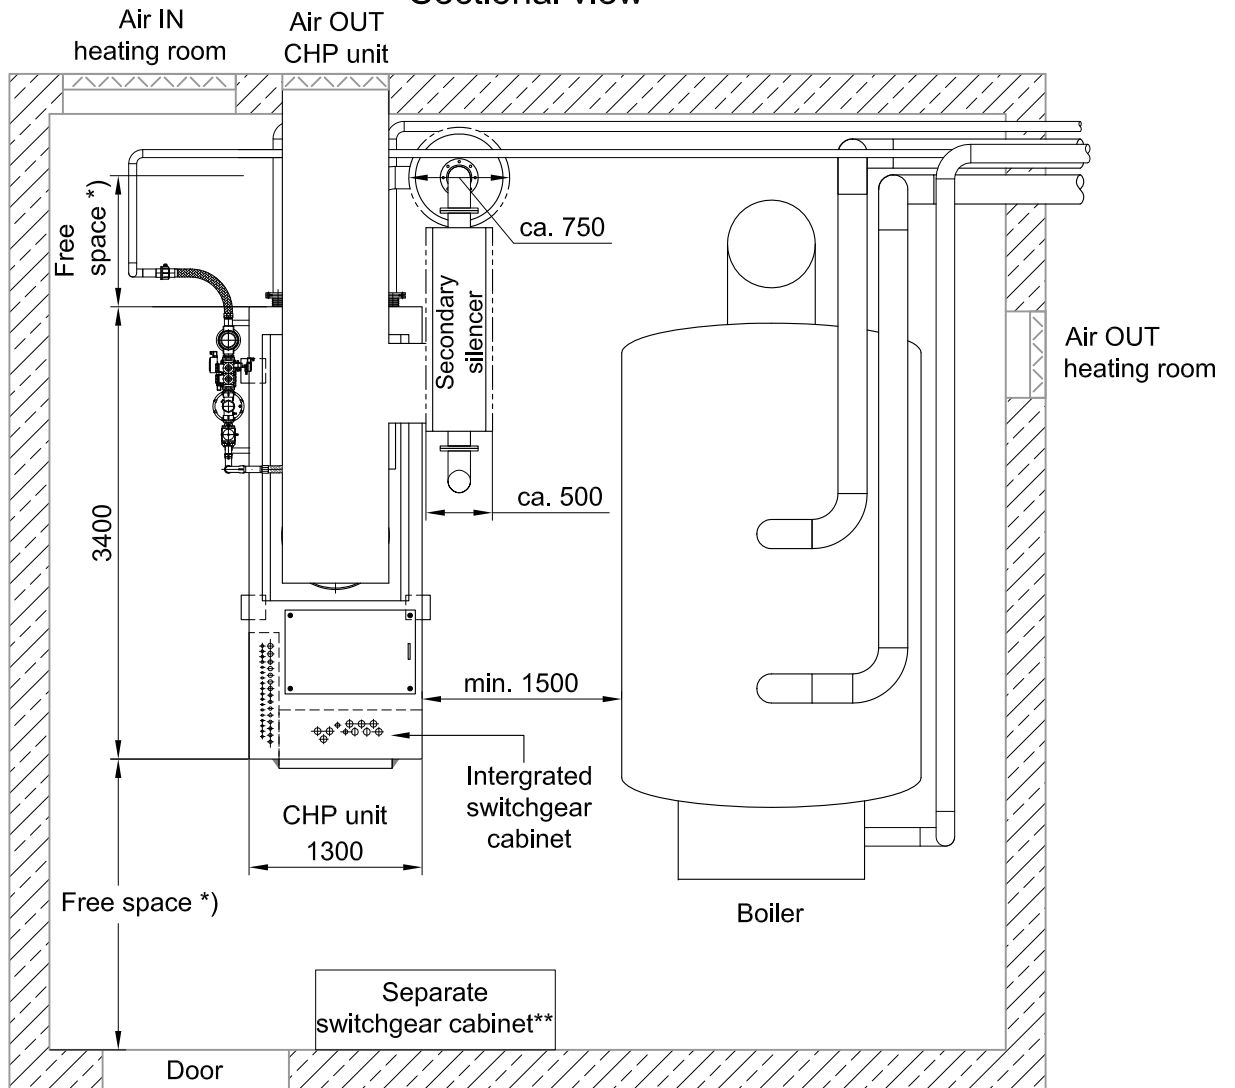

Top view

Door width min. 1400 mm  
 Door height min. 2350 mm

\*) For maintenance works, free space is required: 1000 mm rear (connections side), 1500 mm sideways and 2000 mm front.  
 \*\*) Only if a separate mains distribution panel and/or master control are necessary

(Zul. Abw.)	(Oberfl.)	Maßstab	Skizze	(Gewicht)
<b>SOKRATHERM GmbH</b>				
Layout proposal				
compact CHP unit and Boiler				
Datum	Name			
Bearb. 25.11.2010	Wackerhagen			
Dateiname/Version		GG 201, GG 237, FG 189, FG 250		Blatt 1
PL_SDG250+Boiler engl 10_02				B1ätter
Ursprung	Ersatz für:	Ersatz durch:		